




Dimensiones (mm)

A: Ø140
Altura: 2,9.



Corte: Ø125

Código

KT6617-LV-12W-5K

Descripción

Luminaria tipo bala, diseñada con módulo de LED integrado. Empotrada al techo por medio de sujetadores ubicados en los laterales. Compuesta por un difusor en acrílico opal.



Materiales y acabado

Sujetadores en hierro, recubiertos en plástico inyectado. Resortes en hierro con acabado galvanizado. Cuerpo y aro plástico inyectado.

Color

Blanco.

Características técnicas

LED	 116°	 50,000h	IP 20	IK 02
PF 0,99	THD <10%	°C 0-40	V 100-240	Hz 50/60

Fuente de luz

Bala con módulo de LED.

Potencia de Salida	CRI	K	Lm / W	Lm de Salida
11,4W	>80	5000	104	1187

Características de fuente de luz

- Color temperatura disponible 5000K (luz día).

Light efficiency:



Light quality:



Color temperature:



Output: 1187 lm


Peak: 403 cd

Power: 11,4 W

PF: 0,99



Product name:
E0646-KT6617-LV-12W-5K

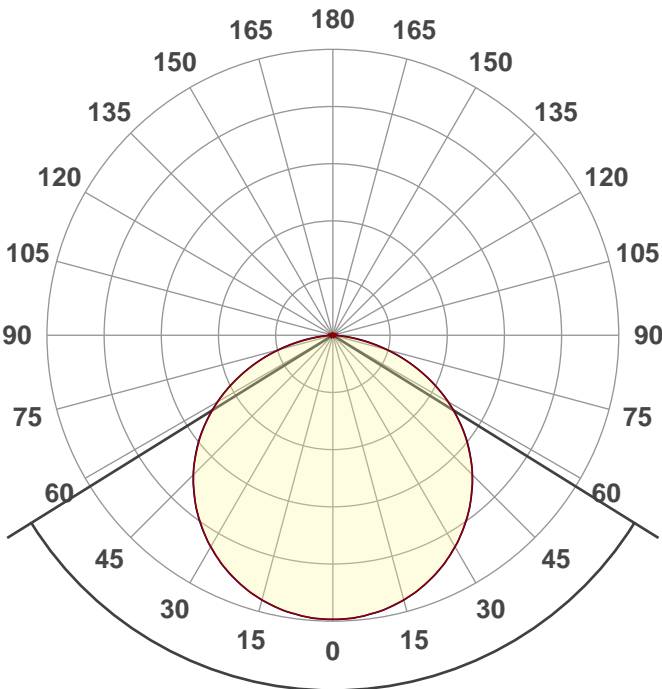

Beam angle **116,2°**




CIE 1931
x: 0,341
y: 0,352

THD Values:


Voltage: 2,02%

Current: 9,35%

Spectra

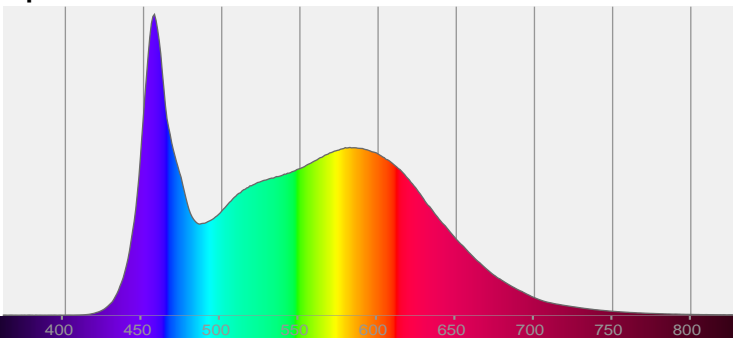


Power

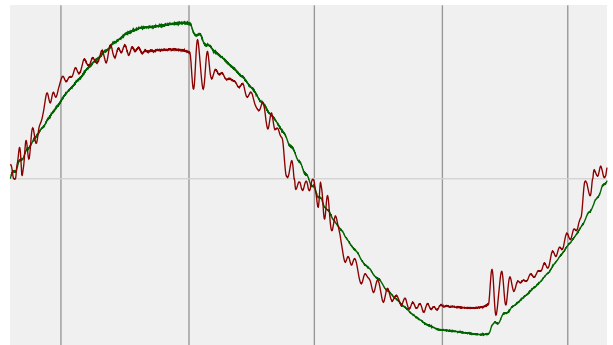

Voltage: 114 V
Current: 0,101 A
Frequency: 60 Hz

ISO Diagrams

ISO lux diagram

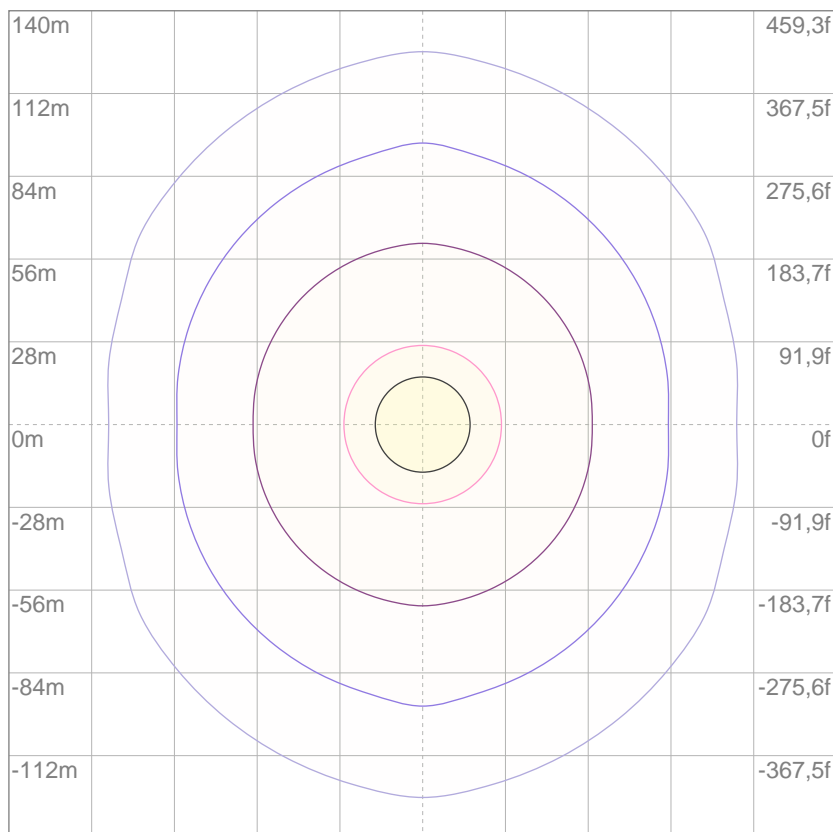


3%	0,121 lx
5%	0,201 lx
10%	0,403 lx
30%	1,21 lx
50%	2,01 lx

Conditions:
 Number of c-planes: 4
 Lux at center: 4,03 lx

Lux distribution on a surface when lamp is mounted at 10 meters from the surface.


Mounting height: 10 meters (33 f)

Color details

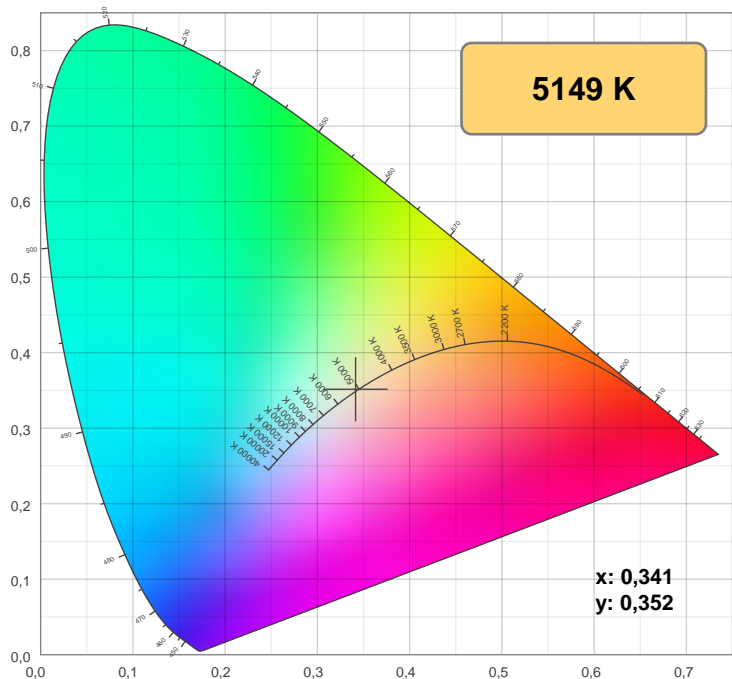

CIE 1931

CRI: 84,9 (R1-R8)

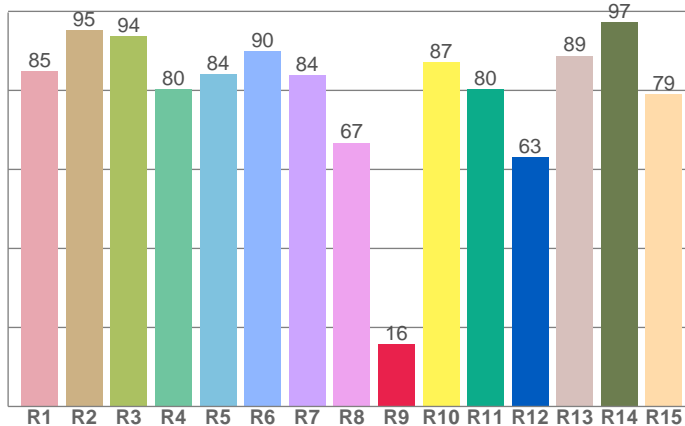

CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
84,9	95,2	93,7	80,2	84,0	90,0	83,9	66,8	15,7	87,2	80,2	63,0	88,8	97,3	79,0

Color parameters







Color temperature	Color rendering index	Red component	Color fidelity	Color gamut	Color quality scale	Color coordinate cie 1931	Color coordinate cie 1931	Color coordinate	Color coordinate	Color deviation from black body
CCT	CRI	CRI R9	TM30 Rf	TM30 Rg	CQS	x	y	u	v	Δuv
5149 K	84,9	15,7	83,1	91,9	81,9	0,341	0,352	0,209	0,323	0,0018

TM-30 details


Rf 83,1
Fidelity index Rf

Rg 91,9
Gamut index Rg

Hue Bin	R _f	Shifts (%)	
		Chroma	Hue
1	75	-12%	2%
2	86	-6%	5%
3	85	-4%	7%
4	89	-3%	1%
5	89	-6%	0%
6	91	-5%	-2%
7	86	-9%	1%
8	82	-9%	7%
9	80	-7%	15%
10	75	-2%	16%
11	80	5%	11%
12	91	5%	-3%
13	84	5%	-12%
14	82	-1%	-11%
15	71	0%	-24%
16	82	-9%	-5%

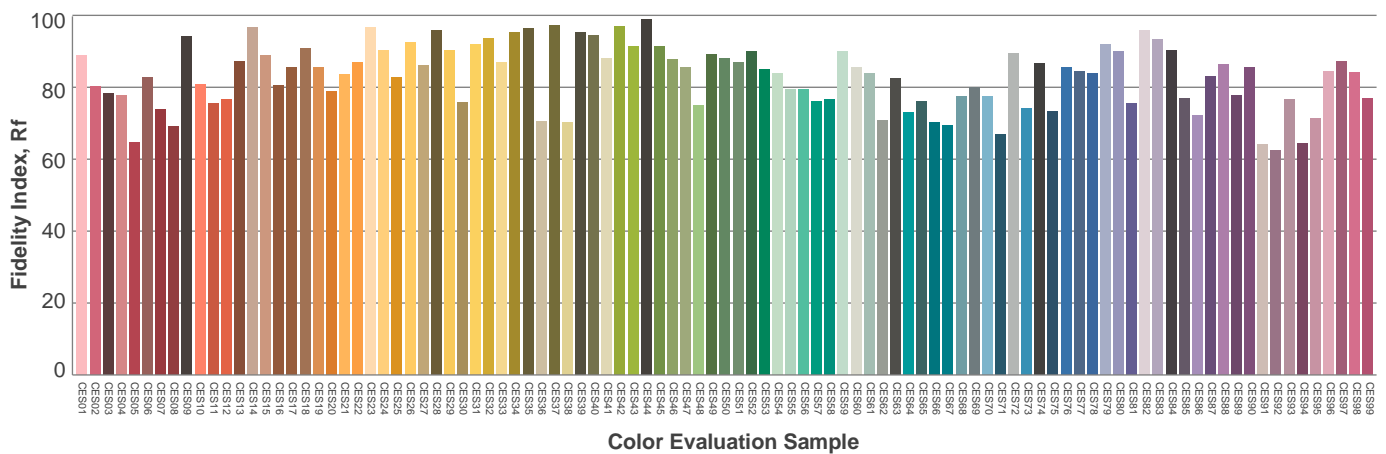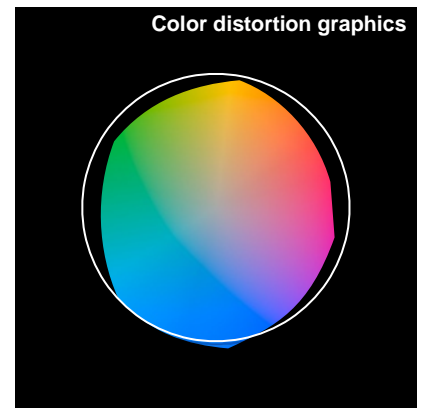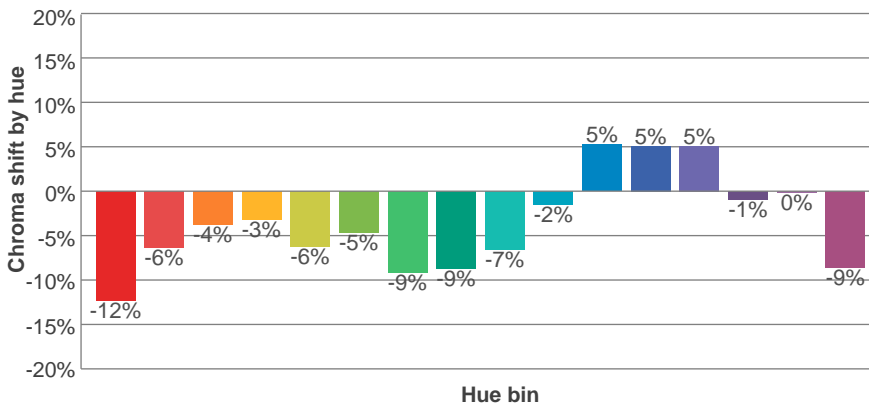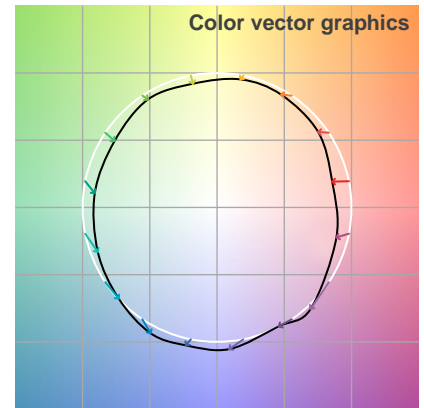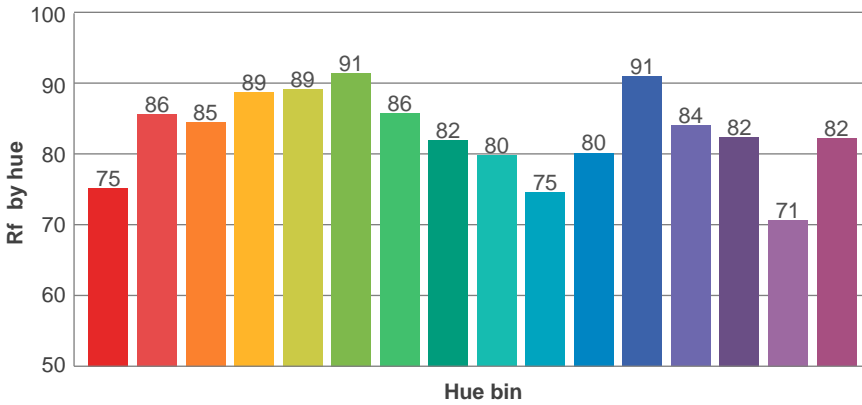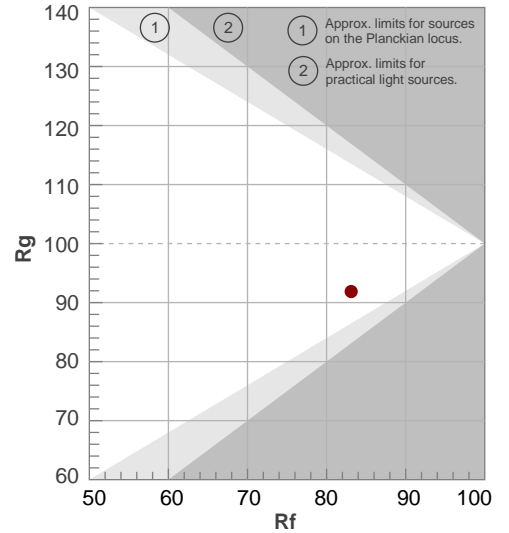

Beam details

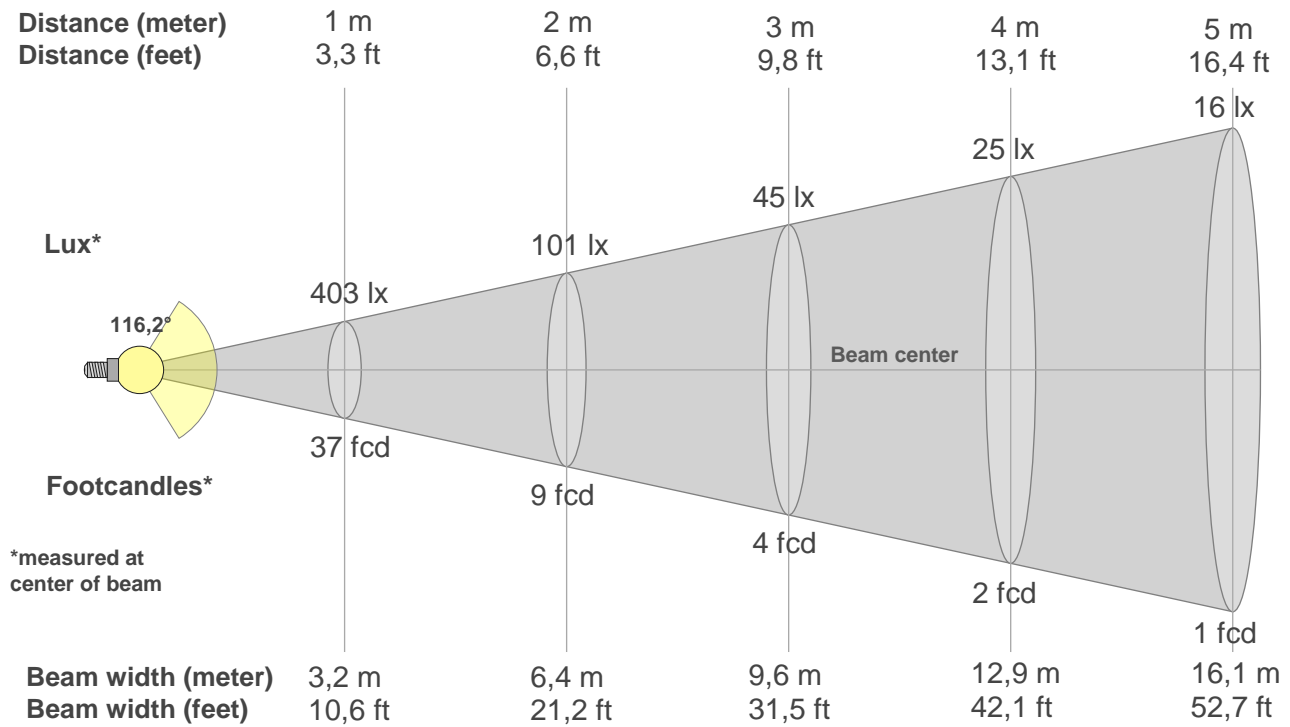

Beam intensities from 1-20m

{BEAM_INT_TABLE_START}

m	m	m	m	m	m	m	m	m	m	m	m	m	m	m	m	m	m	m	m	m
ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft	ft
lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx	lx
fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd	fcd

Intensities in 0° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
403	401	397	388	377	363	346	326	304	279	252	221	188	153	117	79	41	11	0	0
100%	100%	98%	96%	94%	90%	86%	81%	76%	69%	62%	55%	47%	38%	29%	20%	10%	3%	0%	0%

Intensities in 90° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
403	401	397	389	378	363	346	327	305	280	252	222	189	154	117	80	45	15	1	0
100%	100%	98%	96%	94%	90%	86%	81%	76%	70%	63%	55%	47%	38%	29%	20%	11%	4%	0%	0%

Intensities in 180° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
403	401	397	388	377	363	346	326	304	279	252	221	188	153	117	79	41	11	0	0
100%	100%	98%	96%	94%	90%	86%	81%	76%	69%	62%	55%	47%	38%	29%	20%	10%	3%	0%	0%

Intensities in 270° c-plane

0°	5°	10°	15°	20°	25°	30°	35°	40°	45°	50°	55°	60°	65°	70°	75°	80°	85°	90°	95°
403	401	397	389	378	363	346	327	305	280	252	222	189	154	117	80	45	15	1	0
100%	100%	98%	96%	94%	90%	86%	81%	76%	70%	63%	55%	47%	38%	29%	20%	11%	4%	0%	0%

Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
116,2°	160,9°	171,1°	78,6%	52,9%

UGR

Glare Evaluation According to UGR

p Ceiling	70	70	50	50	30	70	70	50	50	30	
p Walls	50	30	50	30	30	50	30	50	30	30	
p Floor	20	20	20	20	20	20	20	20	20	20	
Room size X Y	Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis					
2H	2H	23,9	25,1	24,2	25,5	25,7	23,9	25,2	24,2	25,5	25,7
	3H	25,4	26,7	25,8	27,0	27,2	25,4	26,7	25,8	27,0	27,2
	4H	26,0	27,2	26,4	27,5	27,8	26,0	27,2	26,4	27,5	27,8
	6H	26,4	27,5	26,7	27,8	28,2	26,5	27,6	26,8	27,8	28,2
	8H	26,5	27,5	26,8	27,8	28,3	26,6	27,6	26,9	27,9	28,4
12H	26,5	27,5	26,9	27,8	28,3	26,6	27,6	27,0	28,0	28,4	
4H	2H	24,5	25,8	24,9	26,0	26,3	24,5	25,8	25,0	26,0	26,3
	3H	26,3	27,3	26,7	27,7	28,1	26,3	27,3	26,7	27,7	28,1
	4H	27,0	27,9	27,4	28,3	28,9	27,0	27,9	27,4	28,3	28,9
	6H	27,4	28,3	27,9	28,7	29,0	27,5	28,4	28,0	28,7	29,1
	8H	27,5	28,3	28,0	28,7	29,1	27,6	28,4	28,2	28,8	29,2
12H	27,6	28,2	28,1	28,7	29,1	27,7	28,4	28,2	28,8	29,3	
8H	4H	27,2	28,0	27,8	28,4	28,8	27,3	28,1	27,8	28,4	28,8
	6H	27,8	28,4	28,3	28,9	29,5	27,9	28,5	28,4	29,0	29,5
	8H	28,0	28,5	28,5	29,1	29,7	28,1	28,7	28,6	29,2	29,8
	12H	28,1	28,5	28,7	29,0	29,6	28,2	28,7	28,8	29,2	29,8
12H	4H	27,2	27,9	27,7	28,3	28,8	27,3	27,9	27,8	28,4	28,8
	6H	27,9	28,4	28,4	28,9	29,6	28,0	28,5	28,5	29,0	29,7
	8H	28,1	28,5	28,7	29,0	29,6	28,2	28,6	28,8	29,1	29,7
Variation of the observer position for the luminaire distance S											
S = 1.0H	0,1 / -0,1					0,1 / -0,1					
S = 1.5H	0,2 / -0,3					0,2 / -0,3					
S = 2.0H	0,5 / -0,5					0,4 / -0,5					
Standard table	n/a					n/a					
Correction summand	n/a					n/a					
Corrected glare indices referring to 1187 lm total luminous flux											


Light planning

Coefficients of Utilization

Ceiling reflectance	80				70				50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
RCR	(RCR: Room Cavity Ratio)																			
	Room Values are expressed as percentage of Lumens delivered to the task surface																			
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	109	104	100	96	106	102	98	94	97	94	91	94	91	88	90	88	86	84		
2	99	90	84	78	96	89	82	77	85	80	75	82	77	73	79	75	72	69		
3	90	79	71	64	87	78	70	64	75	68	63	72	66	62	69	65	60	58		
4	82	70	61	54	80	69	60	54	66	59	53	64	58	52	62	56	52	50		
5	75	62	53	47	73	61	53	46	59	52	46	57	51	45	55	50	45	43		
6	70	56	47	41	68	55	47	40	53	46	40	52	45	40	50	44	39	37		
7	64	51	42	36	63	50	42	36	48	41	35	47	40	35	46	39	35	33		
8	60	46	38	32	58	46	37	32	44	37	32	43	36	31	42	36	31	29		
9	56	42	34	29	55	42	34	29	41	33	28	40	33	28	39	33	28	26		
10	52	39	31	26	51	39	31	26	38	31	26	37	30	26	36	30	25	24		

LAMPS (number of lamps)

Luminaire budgetary diagram

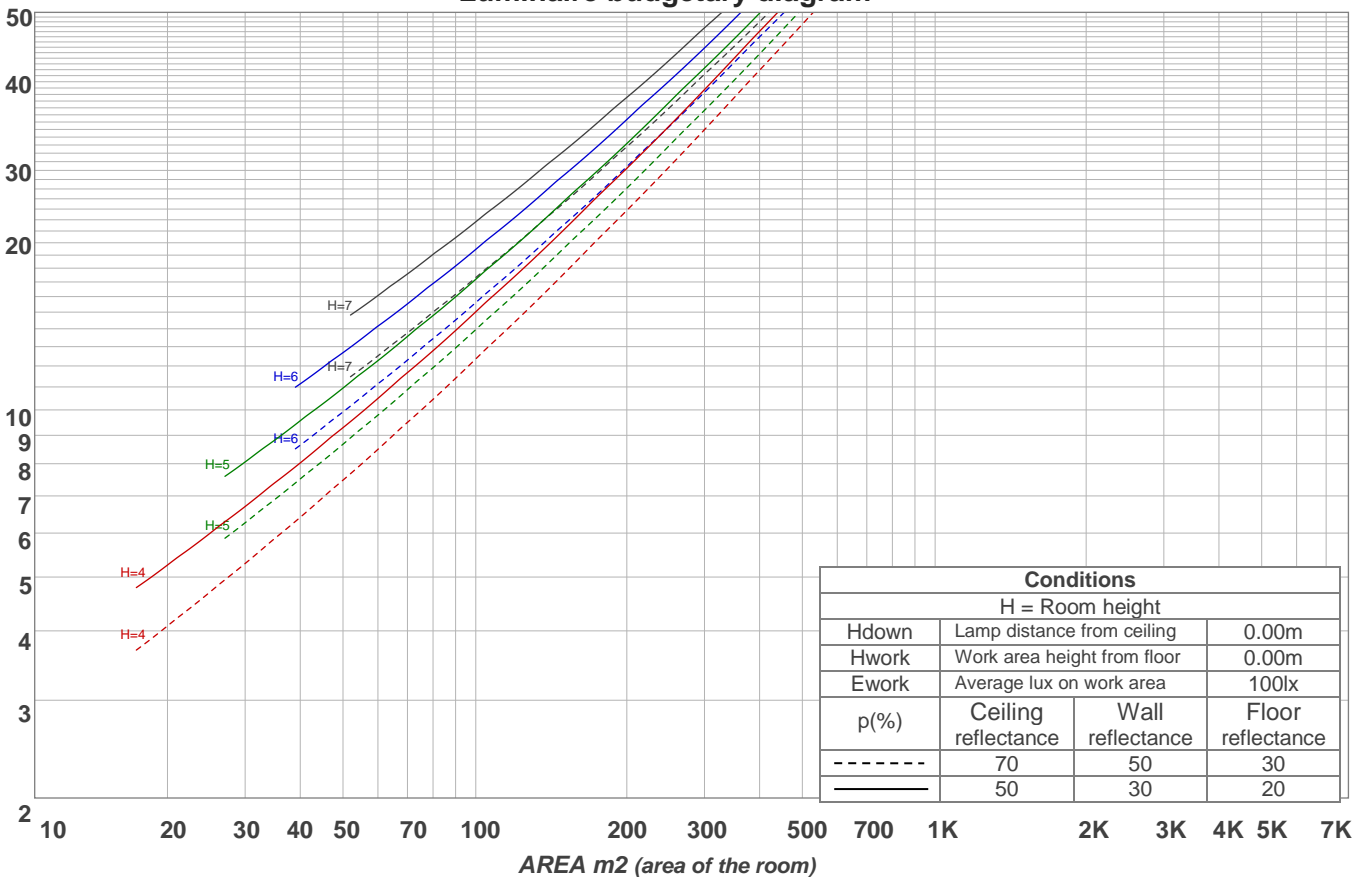


Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
38,2 lm	110 lm	167 lm	204 lm	216 lm	198 lm	152 lm	84,1 lm	17,1 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
0,085 lm	0,055 lm	0,071 lm	0,074 lm	0,070 lm	0,056 lm	0,039 lm	0,022 lm	0,006 lm

Stabilization

Warmup curve

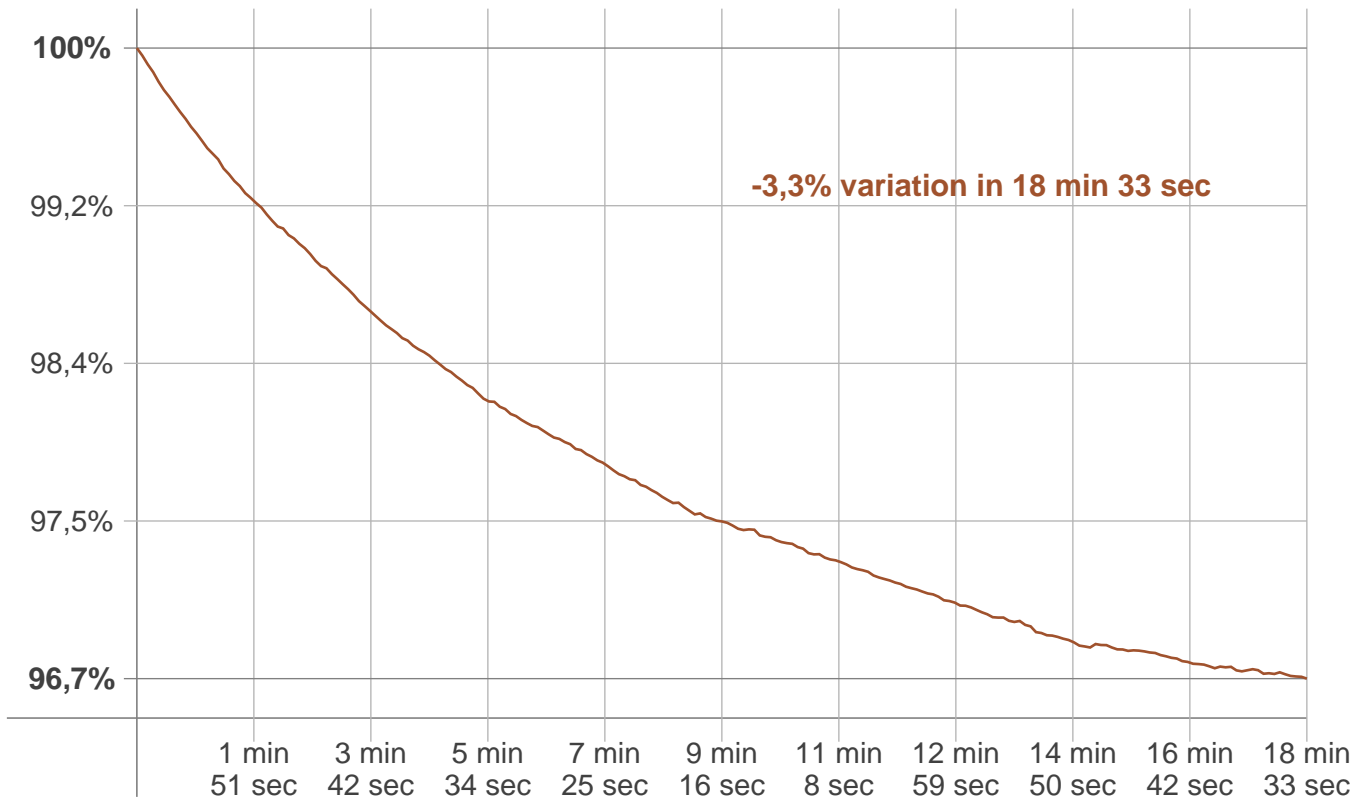

Warmup result

Warmup time:	18 min 33 sec
Warmup variation	-3,3%

Warmup conditions

Stable period:	15 min
Stable change max:	2,0%
Minimum time:	15 min

Color temperature change

CCT start	CCT change	CCT end
5072 K	+77 K	5149 K

Output change

Output start	Output change	Output end
1225 lm	-38 lm	1187 lm